


REVISION No. 2

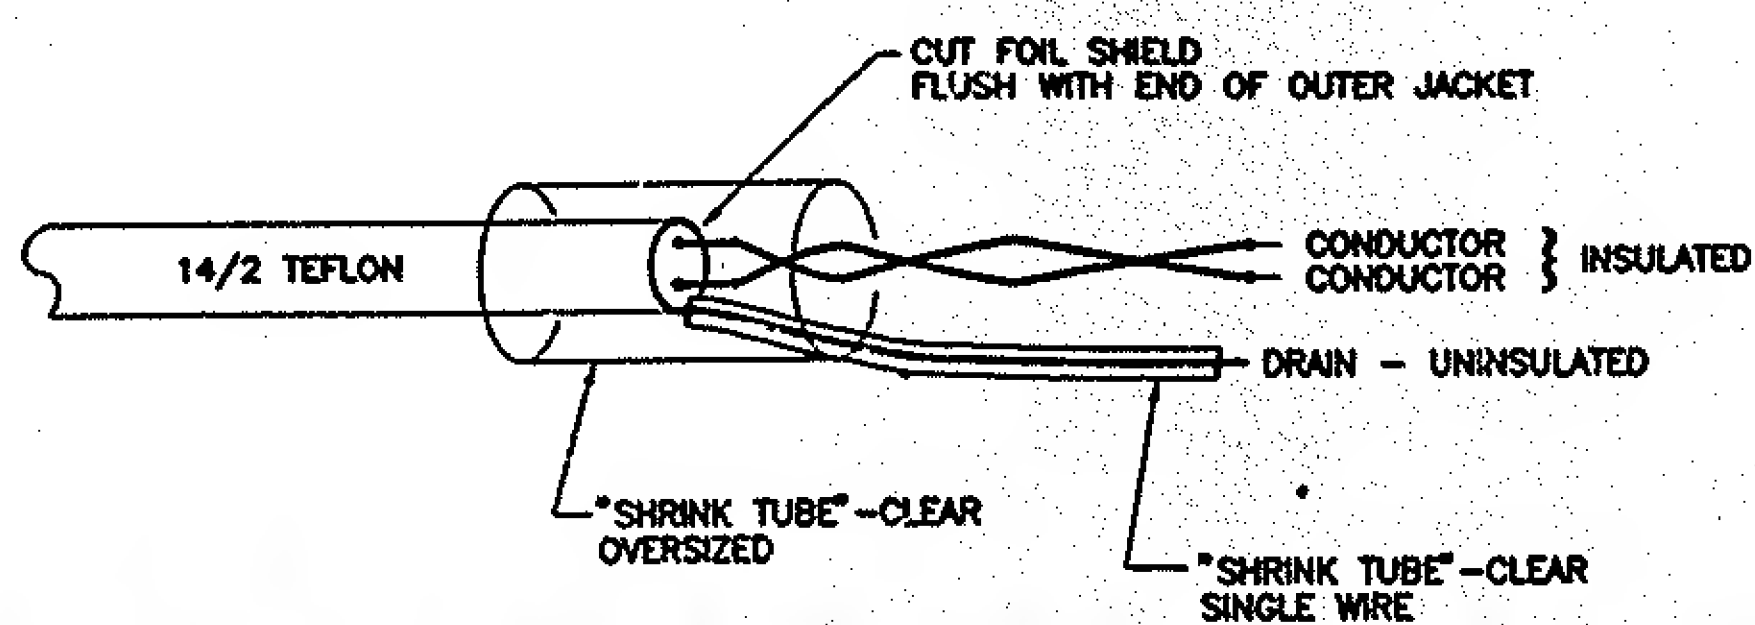

DETAIL "A" - TYPICAL SHIELD/DRAIN INSULATING METHOD

NOTES:


1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG'S E-1 AND E-2.
2. ALL SHIELDS SHALL BE ISOLATED FROM GROUND. APPROVED "SHRINK" TUBING SHALL BE USED ON ALL DRAIN CONDUCTORS. SEE DETAIL "A" (ON THIS DWG).
3. FOR NTC-12 ENCLOSURE LOCATION, SEE DWG E-5.

LEGEND

21UP5

21DN5

+ (R) 2

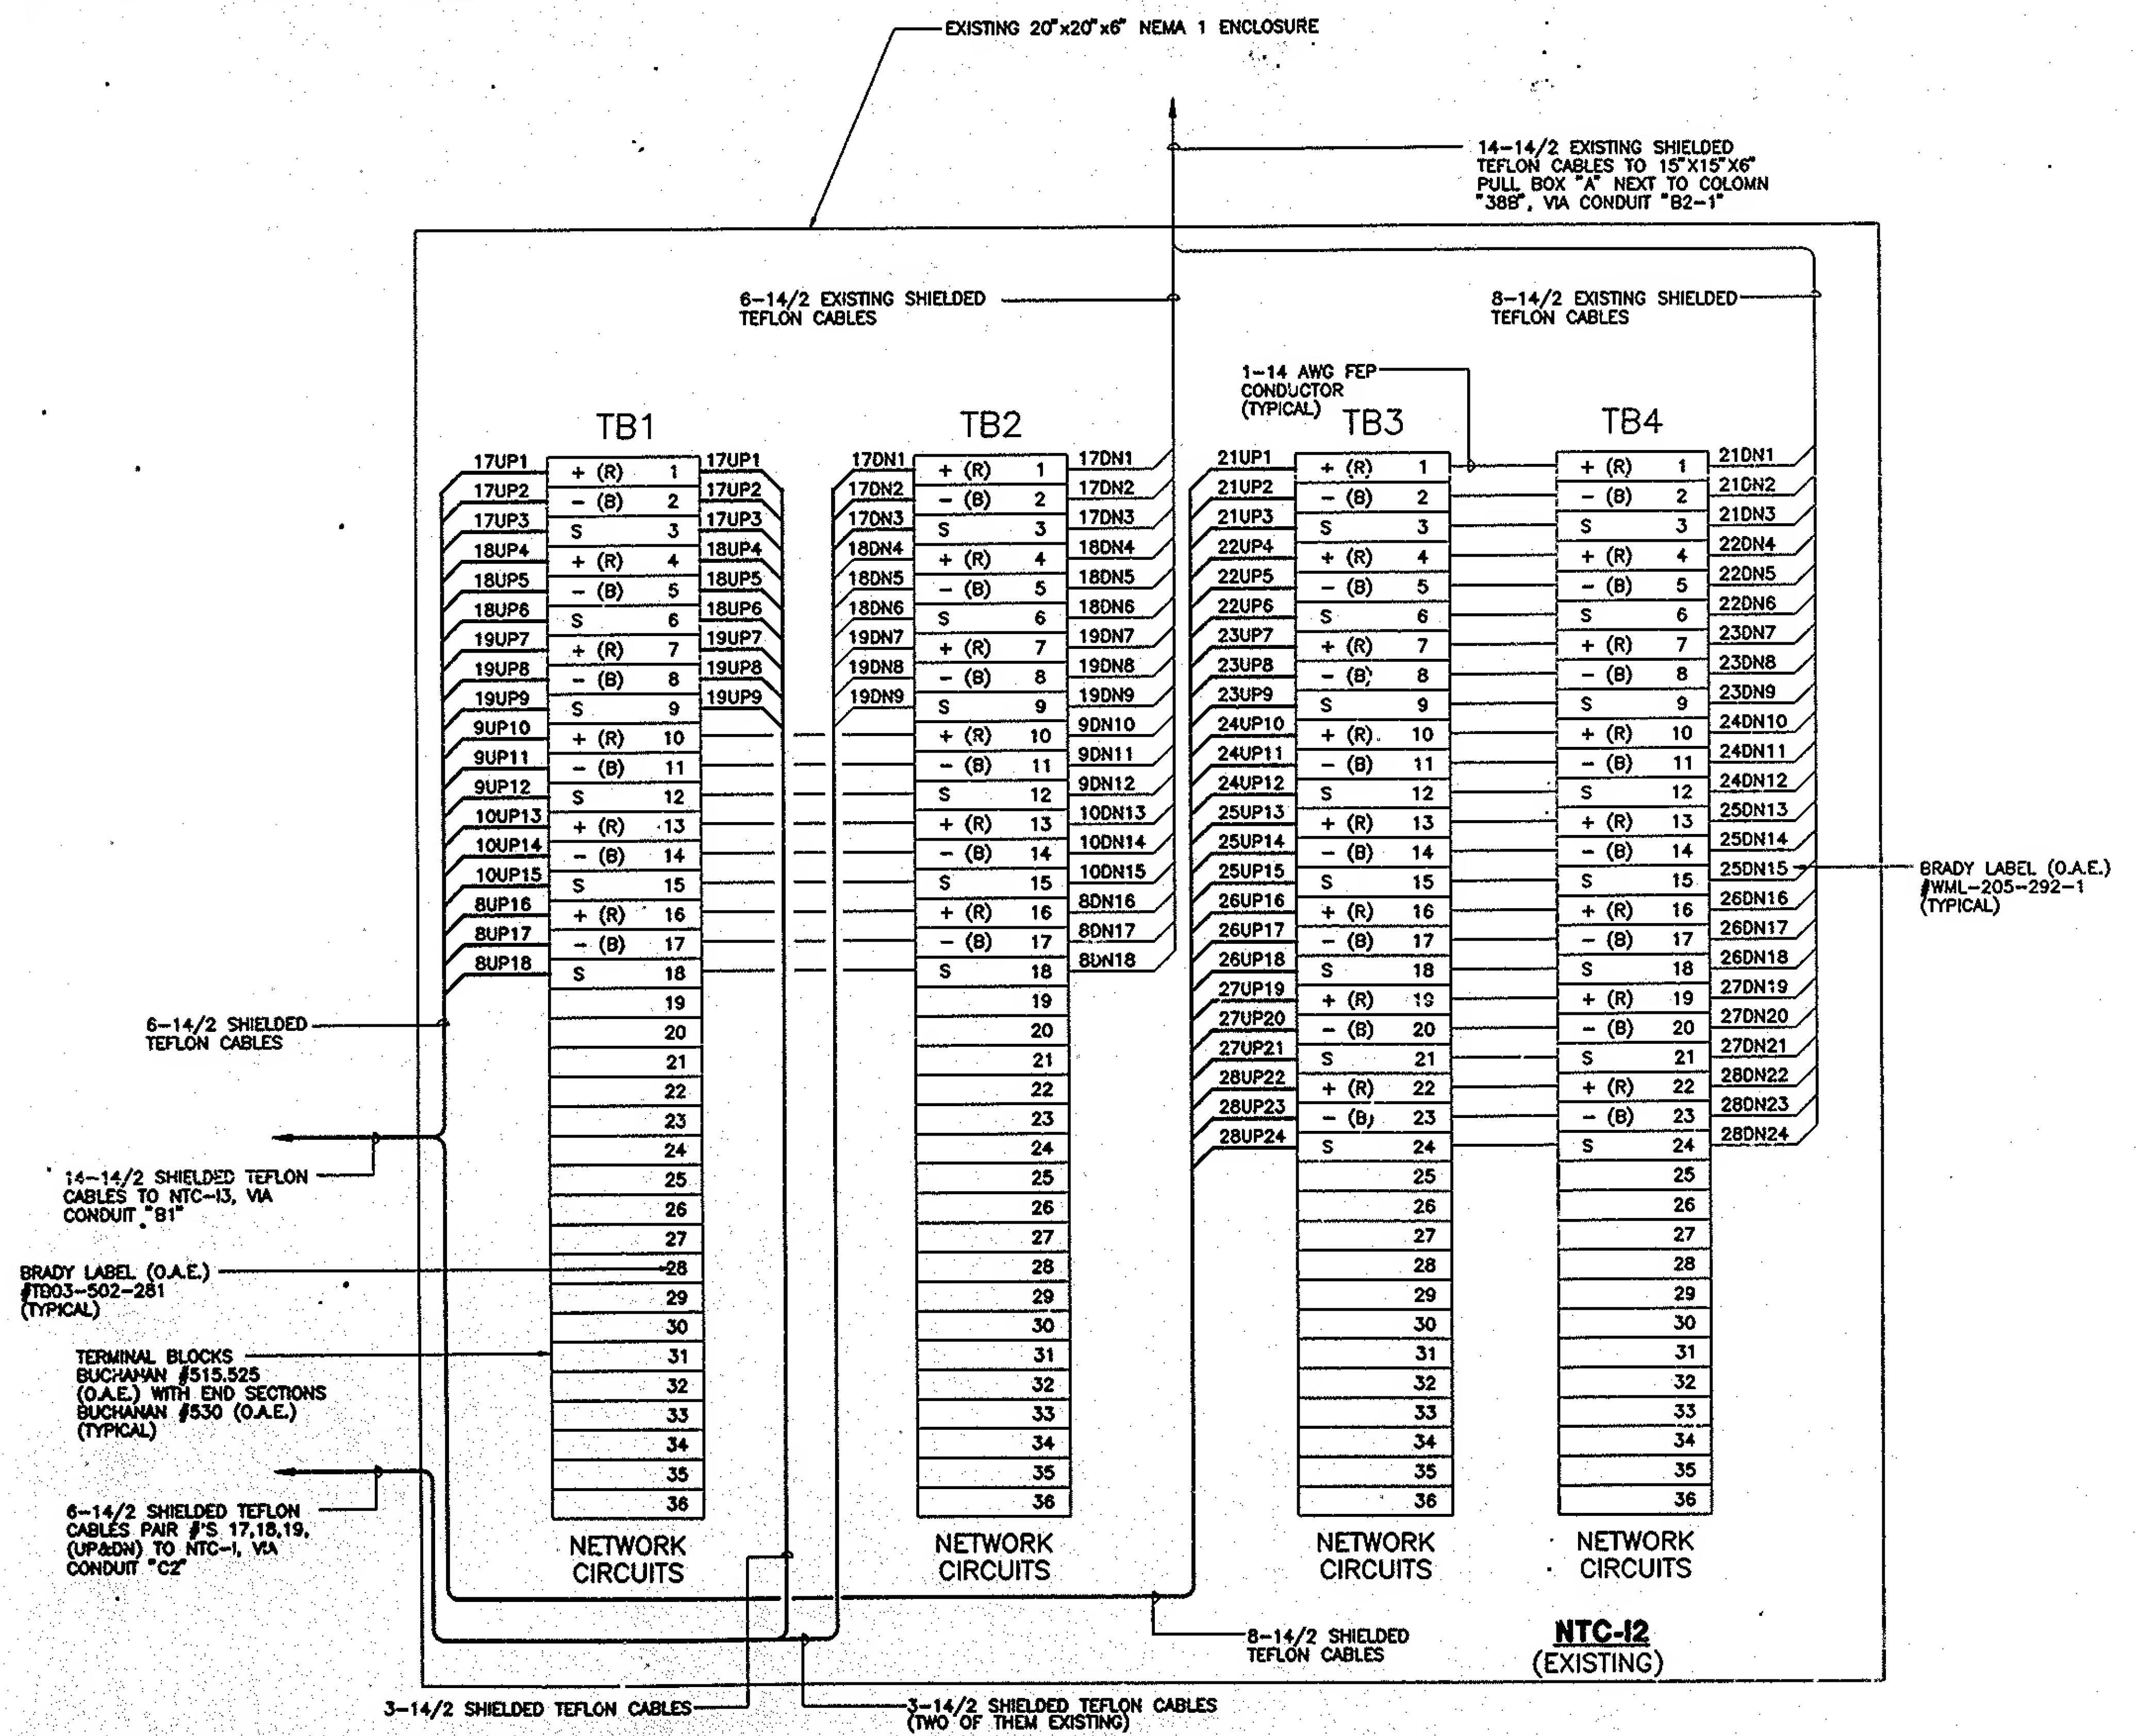

B1 LEVEL